

# Alarms and notifications

The following page provides the description of the alarms and reports that can be configured and used by end-users.

## Description

GoFlex HEMS support the following alarms:


- FOA service is not available (for more than 1 hour)
- IoT linker is offline (for more than 1 hour)
- HEMS controller is offline (for more than 1 hour)

and notification:

- Cyclic device begin the operation cycle

## Configure alarms and notifications

From side menu select **reports** as shown in the following figure.

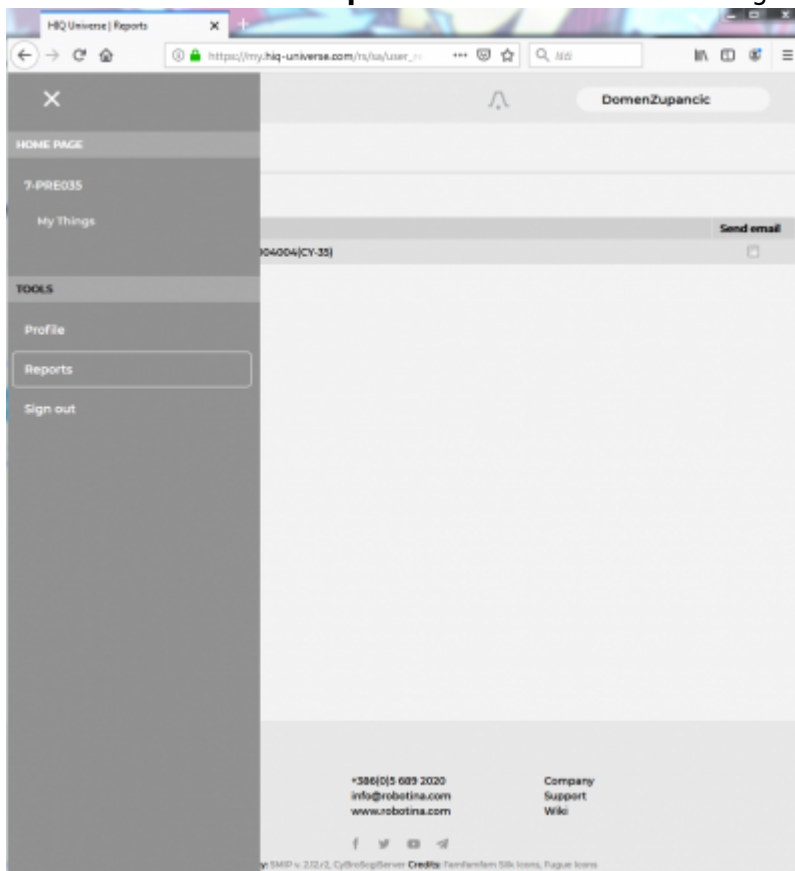

Apply the following steps:

1. Check **send email** checkbox
2. Select language (optional, default is English)
3. Save changes

Last update: 2019/09/06 09:50 en:goflex\_hems:universe:alarms\_notifications http://wiki.hiq-universe.com/doku.php?id=en:goflex\_hems:universe:alarms\_notifications&rev=1567763440

---

From:  
<http://wiki.hiq-universe.com/> -

Permanent link:  
[http://wiki.hiq-universe.com/doku.php?id=en:goflex\\_hems:universe:alarms\\_notifications&rev=1567763440](http://wiki.hiq-universe.com/doku.php?id=en:goflex_hems:universe:alarms_notifications&rev=1567763440)

Last update: **2019/09/06 09:50**

