



myHIQ

myHIQ is a custom application built for specific projects based on CybroMiniScada. It can be fully customized for end-user needs.

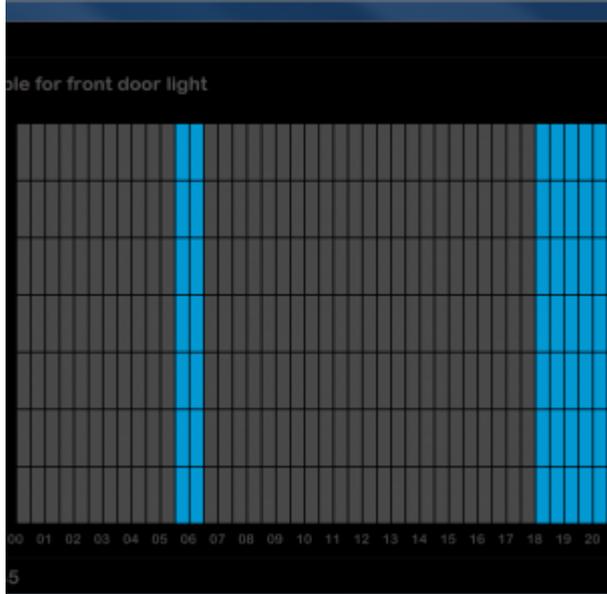

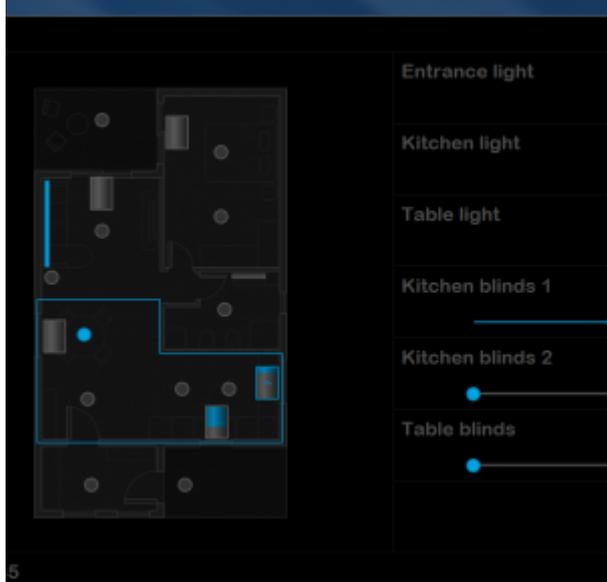

The interface is divided into three main sections. The top section features a floor plan on the left with a temperature callout showing 24.0 and 23.9. To the right, there are labels for 'Thermostat active' and 'Setpoint'. The middle section is a schedule grid titled 'Schedule for thermostat' with a 24-hour timeline (00-23) and a grid of blue and grey cells representing active periods. The bottom section contains three control buttons: a fan icon, a hold icon, and a heat icon. Below these buttons are three temperature values: 25.0 (labeled 'Maximum limit [°C]'), 15.0 (labeled 'Minimum limit [°C]'), and 30.0 (labeled 'Maximum limit [°C]').



[myHIQ demo app](#)

CyBroMiniScada variables

`c1000.lc00_qx00`



home controller address	<code>c+home controller address</code>	find on silver sticker on top of HC-HIQ
--------------------------------	--	---

On/Off devices

All On/Off devices (lights, managed power sockets, exhaust fans, ...) are controlled by LC-10-IQ device controller. myHIQ application displays device status and allows to toggle device output.

Device controller variables

HIQ-DC	id	output	description
LC-10-IQ	lc00..lc04	qx00..qx09	r/w; 0=off, 1=on

Dimmers

Dimmable dVICES (lights and some ceiling fans) are controlled by several device controllers, depending on controlled devices:

- LD-V4-IQ for LED stripes
- LD-P4-IQ for 230 V dimmable lights and ceiling fans
- LD-D8-IQ for DALI lights

myHIQ application displays the device's on / off status and output intensity, and allows to control both.

Device controller variables

HIQ-DC	id	output	description
LD-V4-IQ	ld00..ld04	qx00..qx03	r/w, 0=off, 1=on
LD-P4-IQ		qw00..qw03	r/w; 0..100 %
LD-D8-IQ			

Blinds

Blinds are controlled by a BC-5-IQ device controller. myHIQ application displays and sets the blind position.

Device controller variables

HIQ-DC	id	output	description
BC-5-IQ	bc00..bc01	qxs00up..qxs04up	r/o; 0=off, 1=moving up
		qxs00dn..qxs04dn	r/o; 0=off, 1=moving down
		blinds_position_00..04	r/o; 0..100 %
		blinds_setpoint_00..04	r/w; 0..100 % , -1=stop

Scenes

Scenes are implemented directly in HIQ-HC. There is no need to use scene controller for using scenes from myHIQ application.

Home controller variables

HIQ-HC variable	id	description
scene_status[0]	index=0..31	r/o; 0=scene inactive, 1=scene active, 255=scene not defined
global_scene_request	/	w/o; 0..31=set scene 0..31, -1=idle
global_memory_request	/	w/o; 0..31=memorize scene 0..31, -1=idle

Thermostats

Temperature regulation is done using TH-1M-IQ, TH-1T-IQ or TH-2-IQ thermostat and FC-1-IQ for fan-coils or HC-IQ for radiators.

Device controller variables

HIQ-HC		description	
HC-IQ	hvac_mode	r/w; 0=off, 1=heating, 2=cooling	
HIQ-DC	id	output	description
TH-1M-IQ TH-1T-IQ TH-2-IQ	th00..th04	setpoint	r/w; *0.1 °C (234=23.4 °C)
		temperature	r/o; *0.1 °C (234=23.4 °C)
		humidity	r/o; % RH
		active	r/w; 0=inactive (uses idle setpoint), 1=active (use setpoint)
FC-1-IQ	fc00..fc04	valve	r/o; 0=off, 1=on
		fan_speed	r/o; 0..3

From: <http://wiki.hiq-universe.com/> -

Permanent link: http://wiki.hiq-universe.com/doku.php?id=en:hiq_home:applications:my_hiq&rev=1538744862

Last update: **2018/10/05 13:07**

